



ADDENDUM

PROJECT TITLE: SAINT JOHN POLICE HEADQUARTERS LIGHTING RETROFIT	ADD. NO: 1
TENDER NO: 2023-082303T	DATE: June 14 th , 2023
PAGE 1 of 3 (Including Confirmation Sheet)	

Make the following modifications to the above project. Include in the amount of the Tender, any additions to or deductions from the cost of the work by reason of these instructions.

Sign and attach this Addendum to the Tender documents and submit with your Tender. Failure to do so may result in the rejection of your Tender.

Please note that we are extending the closing of this tender. The new closing date and time will be **Tuesday, June 27th, 2023 at 2:30:00PM Atlantic Time.**

Deadline for Enquiries	Monday, June 19th, 2023 at 4:00:00 pm, ADT
Deadline for Issuing Addenda	Tuesday, June 20th, 2023 at 4:00:00 pm, ADT
Submission Deadline	Tuesday, June 27th, 2023 at 2:30:00 pm, ADT

Please find below some clarification points/questions and answers.

- Q1. What are the security clearance requirements for staff working on this project?
A1. Your staff will need a regular Criminal Background Check.
- Q2. What are the hours of operation?
A2. Monday to Friday, 8:00AM - 5:00PM. No work will be completed after the hours of operations.
- Q3. Will we have access to a small storage area that we can utilize?
A3. Yes, we will accommodate accordingly.
- Q4. Will there be areas we cannot work in during regular business hours?
A4. No, none have been identified.
- Q5. Will we be allowed to use a hammer drill during business hours (specifically in the training room in the basement level of the building) in order to install pipe on ceiling.
A5. Yes, that will not be an issue.
- Q6. Can we have the revised drawings of the layout at the top of stairwell? (i.e. – pendants and pot lights to be moved or deleted.)
A6. Please refer to the attached drawings.

SIGN AND RETURN THIS ADDENDUM WITH YOUR PROPOSAL

BY: Monic MacVicar
 Monic MacVicar, CCLP, CPPB
 Procurement Specialist, Supply Chain Management

 Contractor’s Signature



ADDENDUM

PROJECT TITLE: SAINT JOHN POLICE HEADQUARTERS LIGHTING RETROFIT	ADD. NO: 1
TENDER NO: 2023-082303T	DATE: June 14 th , 2023
PAGE 2 of 3 (Including Confirmation Sheet)	

Q7. I have a follow-up question regarding the attic stock requirement (see section 9.9 – luminaire schedule). I did a quick count of the lamps and ballast requirements and produced the following:

MANUFACTURER	AMOUNT	ATTIC	TOTAL
PHILLIPS LAMP #8T5HE/22-840/IF10/G/DIM/10/1	10	12	22
PHILLIPS LAMP #8.5T8/COR/24-840/MF11/G/10/1	10	6	16
PHILLIPS LAMP #11T5HE/34-840/IF14/G/DIM/10/1	12	12	24
PHILLIPS LAMP #14T5HE/46-840/IF21/G/DIM/10/1	1098	55	1153
PHILLIPS LAMP #24T5HO/COR46-840/IF35/G/DIM/25/1	42	12	54
ADVANCE BALLAST #CN2S28N35M	677	34	711
ADVANCE BALLAST #GOP2PSP32SC	5	3	8
ADVANCE BALLAST #EZ2S28D 35M	44	3	47
ADVANCE BALLAST #CN2S5490CN35M	21	3	24
EIKO LAMP #L3.5WPLS/AB/827/U/GX23/H	67	3	70
EIKO LAMP #L9.5WPLC/A/840/UD/G24Q/O	9	3	12
SYLVANIA BALLAST #QTP2X26/32/42CF/UNV DM	9	3	12
PHILLIPS #7.8MR16/PER/940/F35/DIM/EC/12V/10/1FB	3	3	6
PHILLIPS #16.5PL-L/COR/22-840/IF23/P/4P/DIM/10/1	20	3	23
ADVANCE BALLAST #CN2TTP40SC35M	10	3	13

I've shown the attic stock requirement based on specifications. I want to draw your attention to the highlighted numbers; they seem excessive compared to the actual respective tubes/ballasts installed. Just confirming this is what you want and I will price accordingly.

A7. Please find attached revised Luminaire Schedule.

Also attached are the changes to the drawings.

SIGN AND RETURN THIS ADDENDUM WITH YOUR PROPOSAL

BY: Monic MacVicar
 Monic MacVicar, CCLP, CPPB
 Procurement Specialist, Supply Chain Management

 Contractor's Signature



ADDENDUM

PROJECT TITLE: SAINT JOHN POLICE HEADQUARTERS LIGHTING RETROFIT	ADD. NO: 1
TENDER NO: 2023-082303T	DATE: June 14 th , 2023
PAGE 3 of 3 (Including Confirmation Sheet)	

CONFIRMATION - RECEIPT OF ADDENDUM

**Upon receipt of this document, fax this page to
(506) 658-4742 to confirm receipt of this addendum.**

CONTRACTOR'S NAME: _____

ADDRESS: _____

PHONE: _____ FAX: _____

RECEIVER NAME (PRINT) _____

RECEIVER SIGNATURE: _____



Addendum

120 Millennium Drive, Suite 201
Quispamsis, New Brunswick E2E 0C6
Phone (506) 847-8285 Fax (506) 848-2131
www.mcw.com

Date: June 14, 2023

Project Name: MBDER PKG #A13C – City of Saint John Police Headquarters - Lighting Retrofit

Client: City of Saint John

Project #: 12-22-076
Pkg A13C

To: City of Saint John - Supply Chain Management

ADD #: 1

Attention: Monic MacVicar

supplychainmanagement@saintjohn.ca

Page #: 1 of 4

From: Bob Cormier

+ Attachment

Distribution: Samir Yammine – City of Saint John

Carman Travis - MCW

Louise Goguen - MCW

Tim Dulenty - MCW

In accordance with the drawings and specifications, provide in the tender all costs required to complete the work including items as listed below.

Title: Electrical

Reason for Change: Clarifications from Contractor Walk-Through
--



Electrical Drawings:

Drawing #	Revisions
E-1	<ul style="list-style-type: none">• Reference Detail 1: Ground Floor Part A – Lighting:<ul style="list-style-type: none">• Reference Booking Room 033:<ul style="list-style-type: none">• Provide a new 2-gang stainless steel cover plate to suit the arrangement of the new line voltage wireless dimmer for the eight (8) Type “P” measures in Detention Lobby 082. (A blank and a decora style opening).• Remove the new wireless dimmer shown for the two (2) Type “P” measures. Reuse the existing dimmer.• Reference Corridors 042, 043 and 062:<ul style="list-style-type: none">• Delete twelve (12) Type “P” measures.• Add twelve (12) Type “K” measures.• Reference Sally Port 028 and adjacent Quick Car Clean Up Area:<ul style="list-style-type: none">• Delete nine (9) Type “L” measures.• Add nine (9) Type “B0” luminaires.• Reference Detail 2: Notes:<ul style="list-style-type: none">• Reference Specific Notes:<ul style="list-style-type: none">• Delete Specific Note 2.• Add Specific Note 2 as follows: Relocate existing vapour proof luminaires to Shoot House, Room 019, shown on drawing E-2. Retrofit these relocated luminaires with Type “L” measure. Install new Type “B” luminaires in Parking Garage 006A as shown on plan.• Reference Detail 3: Legend:<ul style="list-style-type: none">• Reference On/Off Photocell Sensor:<ul style="list-style-type: none">• Delete Catalogue Number.• Add Catalogue Number as follows: SensorSwitch# rCMS-6-G2.• Add a 120V Power/Relay Pack for the above mentioned Photocell as follows: nLightAir #rPP20.



Electrical Drawings:


Drawing #	Revisions
E-2	<ul style="list-style-type: none"> • Reference Detail 1: Ground Floor Part B – Lighting: <ul style="list-style-type: none"> • Reference Shoot House Room 019: <ul style="list-style-type: none"> • Add specific Note 5 to the first row of luminaires to feed the relocated luminaire shown. • Reference Vestibule 008 at Column Lines 7/B: <ul style="list-style-type: none"> • Delete Type “CF2” measure. • Add Type “R” luminaire. • Reference Electrical Room 024: <ul style="list-style-type: none"> • Existing Relay Panel ‘ORP1’ is located on wall of Column Line E, not Column Line 8 as shown. • Reference Detail 2: Notes: <ul style="list-style-type: none"> • Reference Specific Note 3: <ul style="list-style-type: none"> • Add the following: Provide stems as required. • Reference Specific Note 4: <ul style="list-style-type: none"> • Delete Note 4: • Add Note 4 as follows: Lower the four (4) existing luminaires and suspend the remaining six (6) luminaires flush with underside of raker beam. Provide necessary stems as required.
E-4	<ul style="list-style-type: none"> • Reference Detail 1: First Floor – Lighting: <ul style="list-style-type: none"> • Reference Main Lobby 1002: <ul style="list-style-type: none"> • Existing low voltage switch and dimmer for upper level luminaires to remain “as is”. • Reference Traffic Management Office 1028: <ul style="list-style-type: none"> • Delete four (4) Type “K” measures. • Add four (4) Type “P” measures. • Provide one (1) line voltage wireless dimmer for Type “P” measures. • Reference Watch Commander Office 1034: <ul style="list-style-type: none"> • Delete two (2) Type “Q” luminaires. • Add two (2) Type “K” measures. • Reference Detail 2: Notes: <ul style="list-style-type: none"> • Delete Specific Note 2:
E-5	<ul style="list-style-type: none"> • Reference Detail 1: Second Floor – Lighting: <ul style="list-style-type: none"> • Reference Upper Main Lobby 1002: <ul style="list-style-type: none"> • Add one (1) 120V Power/Relay Pack and 2C#18 to feed new Photocell Sensor. • Reference Upper Lobby 2001 and Stair No.1: <ul style="list-style-type: none"> • Refer to attached Electrical Sketch SKE-1 for modifications to luminaires deleted and those relocated. • Reference Street Crimes, Room 2075: <ul style="list-style-type: none"> • Delete four (4) Type “Q” luminaires. • Add four (4) Type “K” measures.



Electrical Drawings:

Drawing #	Revisions
E-6	<ul style="list-style-type: none">• Reference Detail 1: Luminaire Schedule:<ul style="list-style-type: none">• Add Type “B0” Luminaire:<ul style="list-style-type: none">• Type B0 luminaire shall be identical to Type B except no built-in occupancy sensor required.• Add Type “R” Luminaire:<ul style="list-style-type: none">• Type “R” shall be as follows:<ul style="list-style-type: none">• JUNO #JSFSQ 12IN 13LM-40K-90CRI-120FRPC-WH.• Reference Detail 2: Specifications:<ul style="list-style-type: none">• Reference Item 9.9 Attic Stock:<ul style="list-style-type: none">• Delete Items 9.9.1.3.• Add Item 9.9.1.3. as follows:<ul style="list-style-type: none">• Provide six (6) T5 LED lamps or 5% whichever is greater.• Delete Items 9.9.1.4.• Add Item 9.9.1.4. as follows:<ul style="list-style-type: none">• Provide six (6) T5HO LED lamps or 5% whichever is greater.

End of ADD # 1

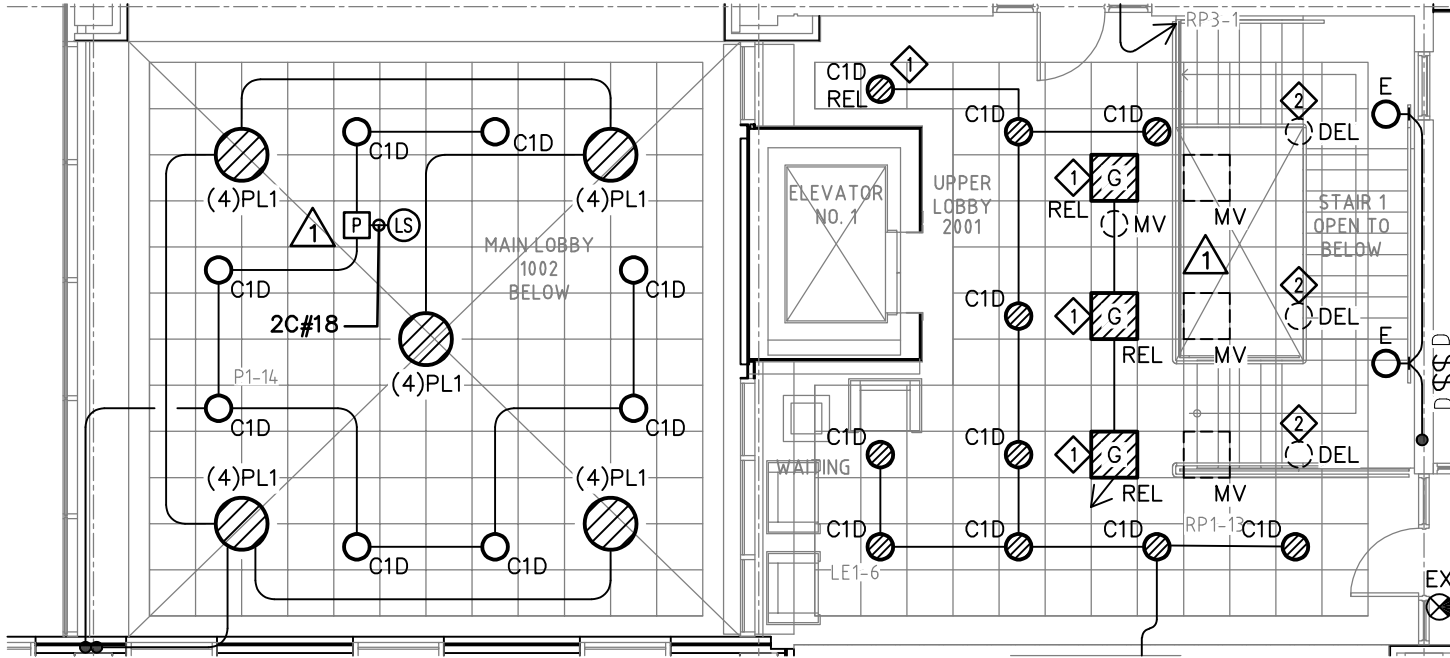

SPECIFIC NOTES:

- ① NO LUMINAIRE IN THIS LOCATION PRESENTLY. EXTEND EXISTING CIRCUIT AS REQUIRED.
- ② PROVIDE CEILING TILE TO MATCH EXISTING.



77 VAUGHAN HARVEY BLVD, SUITE 200
 MONCTON, NB E1C 0K2

Bus: (506) 857-8880 Fax: (506) 859-8393

WWW.MCW.COM ENG. JOB NO. 12-22-076

THIS DRAWING SHALL BE READ IN CONJUNCTION WITH
 ALL OTHER CONTRACT DOCUMENTS

Project
**CITY OF SAINT JOHN
 POLICE HEADQUARTERS
 LIGHTING RETROFIT**

Drawing Title
**SECOND FLOOR
 LIGHTING**

Project No.
 12-22-076

Drawn
 M.J.G.

Date
 JUNE, 2023

Scale
 1:100

Drawing No.

SKE-01