

TRANSMITTAL SHEET

TO: All Bidders
DATE: June 22, 2023
TOTAL NUMBER OF PAGES (INCLUDING COVER PAGE): 6
FROM: Kevin O'Brien, P. Eng. **TEL. #:** (506) 658-2894
Utilities & Infrastructure Services

IF YOU DID NOT RECEIVE ALL PAGES, OR FURTHER INFORMATION IS REQUIRED,
PLEASE CONTACT THE SENDER

MESSAGE:

TENDER NO: 2022-17

**Sydney Street (Broad Street to Tin Can Beach)-
Street Reconstruction and Harbour Passage Extension**

Please find attached a copy of **Addendum #1** for the above tender.

As of March 2021, please be advised that an ***Acknowledgement Form*** (historically sent as part of the City's addendum packages) confirming receipt of an Addendum is **no longer** included in the addendum package.

However, in accordance with Section 2.5.03 of the City's General Specifications, it remains a requirement that **each Addendum** will contain a signature page(s) which each Tenderer is **required to sign and include with its Tender submission.**



UTILITIES & INFRASTRUCTURE SERVICES
Engineering Services
175 Rothesay Avenue
Saint John, NB, E2J 2B4

ADDENDUM

PROJECT TITLE:

**Sydney Street (Broad Street to Tin Can Beach) - Street
Reconstruction and Harbour Passage Extension**

ADDENDUM NO: 1

DATE: June 22, 2023

PAGE: 1 OF 5

TENDER NO: 2022-17

MAKE THE FOLLOWING MODIFICATIONS TO THE ABOVE PROJECT. INCLUDE IN THE AMOUNT OF THE TENDER ANY ADDITIONS TO OR DEDUCTIONS FROM THE COST OF THE WORK BY REASON OF THESE INSTRUCTIONS. THE DATE FOR RECEIVING TENDERS REMAINS AT: **2:30:00PM, TUESDAY, JULY 4, 2023.**

ADDITION TO THE SPECIFICATIONS

Division 2 – Submission of Tender

As a result of the COVID-19 pandemic, the City of Saint John is implementing adjustments to the tender submission procedure as follows:

Section 2.6.01 Location of Tender Box for the Submission of Tender

175 Rothesay Avenue, Saint John, New Brunswick

The tender box will be available at the main building entrance for submission of tenders by the Tenderer between the hours of 9:30 am and 2:30:00 pm only on the above tender closing date. Tenderers shall maintain physical distancing from others when depositing their tender in the tender box.

There will not be a public tender opening. Registered Bidders will receive an email invitation to view the Tender Opening using Microsoft Teams software. Email invitations will be sent to the address provided on the Official Bidder's List. The Tender Opening Committee will conduct the evaluation of the tenders and Compliant tenders will be included in the summary of bids on the City's Tenders & Proposals website within 1 business day following the tender closing.

Division 3 – Particular Specifications

Appendix 3A – Section 32 17 26

Replace clause 3.2.2 with the following:

- .2 Install 2 – 610mm x 610mm plates at each location shown on the drawings, plates to be aligned with the direction of travel for the crosswalk. Align and bolt together plates with 12mm x 50mm bolts and nuts throughout the entire tactile warning surface indicator installation.

Division 4 – Form of Tender

Section 4.5 – Schedule of Quantities and Unit Prices

Replace Sheet 11 of 20 with the Revised Sheet 11 of 20 attached to this Addendum.

ADDITION TO THE DRAWINGS

Sheet 10 of 12:

Detail 5 on Sheet 10 of 12 of the drawing set is to be replaced with the Detail 5 shown on drawing SKC01 attached to this Addendum.

Sheet 12 of 12:

For Detail 4, replace the following note:

“NEMA 1, 30A SERVICE ENTRANCE RATED FUSED DISCONNECT SWITCH INSIDE A NEMA 4X RATED STAINLESS STEEL WEATHERPROOF ENCLOSURE C/W LOCKABLE HINGED COVER. PROVIDE 60A SERVICE ENTRANCE APPROVED FUSES.”

With the following:

“NEMA 1, 30A SERVICE ENTRANCE RATED FUSED DISCONNECT SWITCH INSIDE A NEMA 4X RATED STAINLESS STEEL WEATHERPROOF ENCLOSURE C/W LOCKABLE HINGED COVER. PROVIDE 30A SERVICE ENTRANCE APPROVED FUSES.”

PLEASE NOTE THE FOLLOWING REQUEST FOR EQUIVALENCY:

For the tactile warning surface indicators, the following products shall be considered as equivalent to the Safety Detection System by Bibby-Ste-Croix:

- Duralast Detectable Warning Plate
- Advantage Cast Iron Tactile Walking Surface Indicator

PLEASE SEE THE FOLLOWING RESPONSES TO ENQUIRIES:

Q1: Connections at base of poles, do they require break-away fuse holders?

A1: Luminaires shall be individually fused with 3A fuses at the splice in the pole handhole – as per City of Saint John Street Lighting Best Management Practices

Note: Signed copy of the addendum **must** be enclosed in the tender documents, according to the Instructions to Tenderers and Tendering Procedures in Division 2 of the Contract Specifications.

BY:



CHIEF CITY ENGINEER

CONTRACTOR'S SIGNATURE

TO BE SIGNED AND ATTACHED TO TENDER DOCUMENTS

DIVISION 4
SCHEDULE OF QUANTITIES AND UNIT PRICES

UNIT PRICE TO BE EITHER
TYPEWRITTEN OR PRINTED
IN INK IN WORDS AND
PRINTED NUMERICALLY

CONTRACT NUMBER 2022-17

TITLE: SYDNEY STREET (BROAD STREET TO TIN CAN BEACH)


STREET RECONSTRUCTION AND HARBOUR PASSAGE EXTENSION

ITEM NO.	DESCRIPTION	DIV. NO.	UNIT	EST. QTY.	UNIT BID PRICE		TOTAL (\$)
					WRITTEN	NUMERICAL	
E	CONCRETE CURB AND SIDEWALK	23					
1	<u>Concrete Curb (Regular & Dropped) - Supply & Place</u> Concrete curb (regular & dropped). Excavation and backfill NOT included (Method "B")	23	m	628			
2	<u>Concrete Sidewalk - Supply & Place</u> Variable width concrete sidewalk (Regular and dropped) NOT including excavation and backfill (Method "B")	23	m ²	139			
	b Harbour Passage Walkway -Variable width (Regular and Dropped). NOT including excavation and backfill (Method "B"). Colour shall be "Brick Red" or approved equal.		m ²	740			
	c Supply and install new 610mm x 610mm tactile walking surface indicators at crosswalks complete with required connection hardware		Each	10			
3	<u>Welded Wire Fabric</u> Supply and install 152mm x 152mm welded wire fabric, gauge no. 6/6, as directed by the Engineer	23	m ²	78			

DRAWING NAME: \\CBCL\LAN\CBCL\SAINT JOHN\DATA\PROJECTS\2022\222838.00 SYDNEY STREET RECONSTRUCTION\44 CAD\01 CIVIL\03 DRAWING SHEETS\222838.00 DETAILS REVISED FOR ADDENDUM 1.DWG LAYOUT NAME: SKC01 PLOT DATE: June 21, 2023 4:26:12 PM CAD OPERATOR: TCOLWELL

NOTES:

1. TACTILE WARNING SURFACE INDICATORS SHALL BE DUCTILE IRON OR CAST IRON, PLAIN FINISH.
2. TACTILE WARNING SURFACE INDICATOR PLATES TO BE ALIGNED WITH THE DIRECTION OF TRAVEL FOR CROSSWALK. CONFIRM WITH ENGINEER PRIOR TO INSTALLATION.

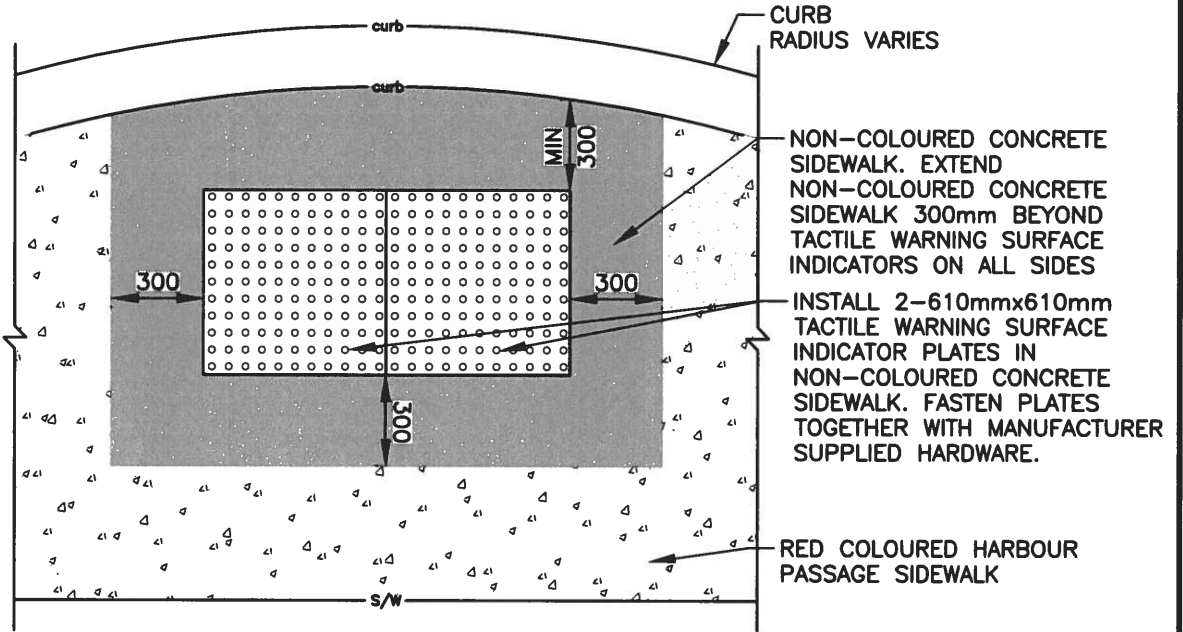

5 **DETAIL—TACTILE WARNING SURFACE INDICATOR**
04/05 1:25

ISSUED FOR ADDENDUM 1							
No.	Description	No.	Description	No.	Description		
Date	Scale	Designed	Drawn	Checked	Approved	CBCL No.	Contract
JUNE 21, 2023	AS NOTED	--	TAC	--	TAC	222838.00	2022-17
SYDNEY STREET (BROAD STREET TO TIN CAN BEACH) STREET RECONSTRUCTION AND HARBOUR PASSAGE EXTENSION						Drawing	
ADDENDUM #1 - REVISED TACTILE WARNING SURFACE INDICATOR DETAIL - DETAIL 5, SHEET 10						SKC01	